

Conf 950725-1

# Field Monitoring of Solar Domestic Hot Water Systems Based On Simple Tank Temperature Measurement

Jay Burch  
Yuantao Xie  
*National Renewable Energy Laboratory*

Clifford S. Murley  
*Sacramento Municipal Utility District*

*Prepared for the American Solar Energy  
Society, Solar 95 Conference,  
Minneapolis, Minnesota, July 15-20, 1995*



National Renewable Energy Laboratory  
1617 Cole Boulevard  
Golden, Colorado 80401-3393  
A national laboratory of the U.S. Department of Energy  
Managed by the Midwest Research Institute  
for the U.S. Department of Energy  
under Contract No. DE-AC36-83CH10093

May 1995

DISTRIBUTION OF THIS DOCUMENT IS UNLIMITED

MASTER

## **NOTICE**

This report was prepared as an account of work sponsored by an agency of the United States government. Neither the United States government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States government or any agency thereof.

Available to DOE and DOE contractors from:

Office of Scientific and Technical Information (OSTI)  
P.O. Box 62  
Oak Ridge, TN 37831  
Prices available by calling (615) 576-8401

Available to the public from:

National Technical Information Service (NTIS)  
U.S. Department of Commerce  
5285 Port Royal Road  
Springfield, VA 22161  
(703) 487-4650



Printed on paper containing at least 50% wastepaper and 10% postconsumer waste

## **DISCLAIMER**

**Portions of this document may be illegible  
in electronic image products. Images are  
produced from the best available original  
document.**

## **FIELD MONITORING OF SOLAR DOMESTIC HOT WATER SYSTEMS BASED ON SIMPLE TANK TEMPERATURE MEASUREMENT**

Jay Burch  
Yuantao Xie  
National Renewable Energy Laboratory  
1617 Cole Boulevard  
Golden, CO 80401

Clifford S. Murley  
Sacramento Municipal Utility District  
PO Box 15830  
Sacramento, CA 95852-1830

### **ABSTRACT**

By dynamically measuring solar storage tank temperature(s), the solar storage tank effectively becomes a dynamic calorimeter to measure the energy flows in a solar system. The energy flows include solar loop gain, tank losses, and potentially draw extraction. With one-channel temperature loggers storing data over several days to several weeks, this approach provides low-cost, modest-accuracy performance assessment, useful for determination of savings persistence and diagnostics. Analysis is based upon the tank energy balance, identifying solar gain during the day and tank losses at night. These gains and losses can be compared to expectations based upon prior knowledge, and estimated weather conditions. Diagnostics include controller and pump operation, and excessive nighttime losses. With one point temperature logger, solar gain accuracy is expected to be 20 to 50%, depending on draw frequency and volume. Two examples are shown, a properly operating system and a system with excessive nighttime losses.

### **INTRODUCTION**

Objectives in field monitoring of solar domestic hot water systems (SDHWS) include direct measurement of energy savings, model validation, persistence of savings or reliability, and system diagnostics. Although limited diagnostics will

follow naturally from this methodology, the objective prompting this work is *reliability*: determine for an ensemble of specific systems what fraction of the potential savings on average is actually realized over time. For reliability monitoring, it is necessary to have relatively large sample sizes. For example, if one wishes to infer that at least 90% of the systems are operating with 90% confidence, then about 22 random samples per system model are required at various times over the ensemble's lifetime. Low-cost metering is essential. An envisioned application of the technique discussed in this paper is as follows: SDHWS maintenance contractors install simple loggers during routine site visits, the logger is mailed by the homeowner to an analyst, and the results feed into a national reliability data base establishing savings persistence. The accuracy required for reliability monitoring is less than that required for model validation or direct performance determination. If the minimum objective is to identify whether the system is in "working" or "non-working" categories, then a measurement of solar savings to about 50% is adequate. There are several approaches to low-cost reliability monitoring (1). The focus here is on a direct approach, measuring the tank temperature and directly inferring the solar storage gain and losses, using the storage tank as a calorimeter.

Tank temperatures are commonly used in SDHWS monitoring. The Solar Rating and Certification Corporation requires a temperature probe in the top of the solar tank (2). The temperature at the top of the solar tank is a good indicator of

system operation, especially for well-mixed systems. The method discussed in this paper is basically a quantitative use of tank temperature data. In (3), temperatures at the top of the tank, and on the solar loop supply and return were used. Temperatures were logged with small data loggers about once every 10 minutes. The loggers operated several weeks, and data was examined visually for expected heat-up patterns and temperature differences. Malfunctioning of the recirculation controller at night was detected in one case. The method in this paper similarly logs tank temperatures, with the addition of quantitative comparison to expected performance. The approach of measuring tank average temperature by attaching probes to tank wall, and using the tank as a calorimeter was used in (4). That study was on a high-flow system under conditions of no draw and an isothermal start, and the objective was to determine the HWB model representing the system. It was also shown that a correction to the temperature should be applied, particularly for dynamic analysis, as there are offsets and delays in the temperature response due to attaching probes to the tank wall. Similar corrections are needed in this study, although dynamics are not generally important.

The experiment installation used here is particularly simple, taking several minutes per sensor. Tank temperature can be measured in several ways, including use of point probes (like thermistors) on the side of the tank, or immersed line-averaging probes (like the RTDs used in HVAC duct measurements). There are distinct advantages to using averaging probes. For this work, discrete temperature probes are attached to the side of the tank. To avoid excessive temperature offset between tank wall and water, it is necessary that insulation cover the probe and surrounding tank wall; the typical tank insulation (typically 3 to 5 cm.) is usually sufficient. Thermal grease is applied and the greased probe is taped securely to the tank wall. In this study, an access port just below mid-height of the solar storage was typically used, and covered with fiberglass insulation. A small hole could be drilled through the outer steel jacket, if necessary. Low-cost (\$120) temperature data loggers holding 8000 data points at user-specified averaging intervals were used, with storage intervals typically set to about 3 minutes. In the remainder of this paper, the focus is on the analysis methods and results from two field installations.

## THEORETICAL BASIS

A correctly operating solar system shows certain characteristic tank temperature patterns, as shown in Fig. 1. There will be temperature increase during the day (0-45C, depending on draw), and temperature decrease at night (several degrees per hour, depending on environmental temperature). These qualitative observations are sufficient for identifying the

system as functioning or not. For more quantitative analysis, we can derive the tank loss coefficient (which will indicate anomalous nighttime losses), determine the controller on times, and compare net daytime energy gain to an expectation dependent on operating conditions. Consider an energy balance on the solar energy storage, as shown in Fig. 2. The dynamic balance can be stated as:

$$(1) \dot{Q}_{\text{solar}} + \dot{Q}_{\text{draw}} + \dot{Q}_{\text{loss}} = \dot{Q}_{\text{int}} = (V_{\text{tank}} \cdot C_{\text{vol}}) \cdot \dot{T}_{\text{tank}}$$

where:

$$\begin{aligned} Q_{\text{solar}} &= \text{solar loop energy} \\ Q_{\text{draw}} &= \text{draw energy} = C_{\text{draw}}(T_{\text{out}} - T_{\text{in}}) \\ Q_{\text{loss}} &= \text{tank loss} = UA_{\text{tank}}(T_{\text{env}} - T_{\text{tank}}) \\ Q_{\text{int}} &= \text{internal energy} = V_{\text{tank}}C_{\text{vol}}(T_{\text{tank}}) \\ V_{\text{tank}} &= \text{tank volume} \\ C_{\text{draw}} &= \text{draw capacitance flow rate} \\ T_{\text{env}} &= \text{tank environment temperature} \\ T_{\text{tank}} &= \text{average tank temperature} \\ V_{\text{tank}} &= \text{tank volume} \\ C_{\text{vol}} &= \text{volumetric heat capacity} \\ \text{over symbol} &= \text{denotes time derivative} \end{aligned}$$

By measuring tank temperature dynamically, and computing temperature derivative, the  $Q_{\text{int}}$  term can be calculated if  $V_{\text{tank}}$  is known.  $V_{\text{tank}}$  can be taken from nameplate rating, to an accuracy of +0,-10%. (Better accuracy can be achieved using measured volume, if available.) The energy balance thus provides direct measurement of  $(Q_{\text{solar}} + Q_{\text{draw}} + Q_{\text{loss}})$ , and the problem becomes how to separate these terms.

### Tank loss calculations

It is reasonable to analyze late-night periods when the solar loop is not operating, and to assume that there is no draw. In this case, the typical nighttime temperature decays as shown in Fig. 1 provide the basis for analysis. Qualitatively, a decay of several degrees per hour is "normal" behavior. Quantitatively, one can calculate  $UA_{\text{tank}}$ , given  $T_{\text{env}}$  estimate. If a probe is attached to the tank inlet or outlet piping, we can usually infer  $T_{\text{env}}$ , when the pipe has equilibrated with the environment. (Such a probe can also be used as a draw indicator, see below.) From the temperature decay between time  $t_1$  to  $t_2$ ,  $UA_{\text{tank}}$  is inferred assuming constant  $T_{\text{env}}$  (the analysis is easily generalized for varying  $T_{\text{env}}$ ):

$$(2) UA_{\text{tank}} = \frac{C \cdot \ln[(T_{\text{tank}}(t_1) - T_{\text{env}}) / (T_{\text{tank}}(t_2) - T_{\text{env}})]}{t_2 - t_1}$$

This value can be compared to a general expectation, e.g., about two to five times the value based upon nominal tank

insulation. When this value is not within these bounds, one can hypothesize that the check valve has failed, the pump is operating at night (controller failure), insulation is missing or defective, or that a small, steady draw (e.g., leaking faucet) is present. For antecedent solar analyses, one can now consider  $Q_{loss}$  a known correction term in the energy balance.

### Solar calculations

There are two useful data analysis approaches: dynamic and integrated. The dynamic approach is based directly upon Eqn. 1, with direct computation of the time derivative of  $T_{tank}$  (with suitable smoothing on the order of one hour) providing dynamic net energy gain. An example is shown in Fig. 3. Integrated analysis is based on integration each day of Eqn. 1 from the beginning to the end of solar operation,  $t_{begin}$  to  $t_{end}$ :

$$(3) \quad Q_{solar} + Q_{draw} = V_{tank}C_{vol}[T(t_{end}) - T(t_{begin})] - Q_{loss}$$

The times  $t_{begin}$  and  $t_{end}$  are detected by searching for the first and last times of positive temperature derivative between sunrise and sunset. In either case, the average value of  $(t_{end} - t_{begin})$  should be a reasonable fraction of the sunrise to sunset time, as a diagnostic of controller operation.

The unpredictable draws inherent in field data are a fundamental complicating factor: in principle, only the sum  $(Q_{solar} + Q_{draw})$  can be inferred. When draws are present,  $(Q_{solar} + Q_{draw}) < Q_{solar}$ , since  $Q_{draw} < 0$ . With point probes, it may be useful to place a "draw indicator" temperature probe on a inlet or outlet pipe, which would indicate when long and/or frequent draws were occurring. Problems can arise due to thermosiphoning from the hot tank, dictating careful placement of the probe. If  $T_{tank,out}$  is monitored, it serves triple duty as a draw indicator, draw temperature probe, and  $T_{env}$  probe, as shown in Fig. 4. Presence of draws are detected by sharp changes in the temperature. When draws are unknown (as with one probe case), the net expected  $(Q_{solar} + Q_{draw})$  should be a continuum from zero (or even negative) to some upper bound corresponding to  $Q_{solar}$  on a clear day with no draws.

A system model is necessary to provide a normalized expectation of daytime performance. The normalization accommodates the fact the performance will certainly depend upon system characteristics (e.g., collector size), weather (e.g., irradiance), and system operating temperature (e.g., dependent upon draw). In general, the geometry and characteristics of the system can be assumed known from observation at the site, although there can be ambiguities (e.g., absorber type). The model complexity can vary from a simple collector model to a dynamic component simulation model; the appropriate choice would appear to depend upon accuracy desired and availability

of weather data. There are probably two useful model-analysis combinations: dynamic model and dynamic analysis, or integrated analysis with simple collector model.

Simulation and dynamic analysis is the most complex, but potentially yields the highest density of data points to assess system operation. This is most useful when draws are frequent. Dynamic weather data is needed to drive the model for dynamic comparison. Highest accuracy would be achieved when a nearby location provides weather data. In the likely event no such data is conveniently available, one would have to make approximate estimates, and realistically restrict detailed analysis to mostly clear periods, when irradiance is reasonably estimated. Cloud cover and ambient temperature can be determined from occasional observation near the site, or from newspaper reports.

A simple collector model combined with integrated data analysis appears best when no weather information is available easily. This method is chosen for the examples presented below. The sum of  $(Q_{solar} + Q_{draw})$  computed via Eqn. 3 can be compared to the daily expected  $Q_{solar}$  based upon estimated temperature and irradiance, as shown in Fig. 5. In this comparison, we first cast the calculated net energy gain into a "clear day efficiency", defined as dividing the net collected energy by expected clear day collector incidence; this allows direct comparison to the collector model, as an upper bound. The collector operating parameter  $T^* = (T_{inlet} - T_{ambient})/I_{incident}$  is taken as an irradiance-weighted daytime average value. The  $T_{inlet}$  value is taken as the measured tank temperature, possibly with an offset based on estimated heat exchanger effectiveness. The daytime average  $T^*$  value should be weighted toward noon-time values, where incidence angles are smallest and energy collection is largest. In the examples below, the average  $T_{inlet}$  value was taken as the mid-day value, and irradiance average was taken as  $631 \text{ W/m}^2$  ( $200 \text{ BTU/h-ft}^2$ ).

### Error estimation

Error estimation depends on the data available and the analysis approach chosen. Error is illustrated for the approach of a simple collector model used with integrated analysis, and we treat two cases of tank temperature approach: a) a single mid-tank temperature probe; and b) a line-averaging probe. Estimated errors in the quantitative analysis are shown in Table I, starting with independent variables and proceeding through derived quantities. With a single temperature probe, error estimate for average tank temperature is difficult, due to draw-induced stratification affects. It is possible, for example, that a combination of draws and solar operation could occur which result in little change of the measured tank mid-point temperature, and net energy calculated is quite erroneous (100% error!). Such occurrences are expected rarely, as seen in

the examples and as expected from typical residential draw patterns dominated by morning and evening draws, especially for weekdays. The 10 °C error in temperature change is a conservative estimate, based on estimates of stratification affects potentially dominating roughly 1/3 the time (weekends). For the line-averaging probe, the presence of draws are detectable, and stratification has no significant affect in the analysis. The error in  $UA_{tank}$  is dominated by error in estimate of  $T_{env}$ , of about 5 °C. Accuracy would be increased by installation of a sensor (such as on the outlet pipe) which gives some measurement of  $T_{env}$ .

TABLE 1. ERROR ANALYSIS

Variable	Point probe	Line-average
$T_{end} - T_{begin}$	10 °C	2 °C
$V_{tank}$	5%	5%
$\eta_{measurement}$	30%	11%
$UA_{tank}$	70%	60%
$T_{col, inlet}, T_{ambient}$	5 °C	5 °C
$I_{clear\ day}$	15%	15%
$T^*$	50% (typ.)	50% (typ.)
$\eta_{model}$	11%	11%
$\eta_{total}$	32%	16%

The error in the calculated value of the daily average operating parameter  $T^* = (T_{inlet} - T_{ambient})/I_{incident}$  is about 50%, at typical operating conditions for the examples below. This uncertainty propagates to about 4% uncertainty in efficiency, which is about 11% of the energy collected. The model error is reduced when measured weather data is available. If the model error is added in quadrature with the measurement error, the total efficiency error is roughly 30 to 40% in the case of the point probe, or about 10-20% for the line-average case.

## EXAMPLES

During September 1994, three systems installed under the Sacramento Municipal Utility District Solar Program (5) were monitored for 17 days each (logger capacity at 3 min. storage intervals). The weather was mostly clear and warm, highs ranging from 25°C to 35°C. Two indirect glycol loop systems with a wrap-around tank-heat exchanger, and a drainback system were monitored, in all cases with multiple probes to test sensitivity to number of probes. Software to perform the analyses described above was written, and a standard report format was developed to provide detailed results for the entire data sets. In all cases, the conclusions reached based upon a single probe at mid-height of the solar storage were equivalent to conclusions with large number of probes, and it was concluded that use of a single probe appears adequate. Partial

results are reported here based upon data from a single probe installed near mid-height of the solar storage, and estimated ambient temperature based upon long term average weather.

Tank temperature data for site 1 are shown in Fig. 1. The average value for  $UA_{tank}$  was 7.8 +/- 5 W/C. The nominal value for  $UA_{tank}$ , derived from the manufacturer's quoted R value, is 1.8 W/C. The measured  $UA_{tank}$  is about 4 times the nominal value, well within usual bounds. The controller was on about 7 hours per day, which is about 60% of the sunrise/sunset time. This is a reasonable figure for mostly clear weather. The values of ( $Q_{solar} + Q_{draw}$ ) inferred from the daytime temperature change ranged from 7.7 to 35.7 MJ/day (7.3 to 34 kBTU/day). The daily "clear day efficiency" points are shown against the collector efficiency plot in Fig. 5. It can be seen that most of the points fell significantly below the collector curve, with some approaching the curve. This is indicative of normal daytime solar collection. There was not much variation in the daily operating conditions, as seen by the lack of spread in the data points.

Tank temperature data for site 2 are shown in Fig. 6. By comparison of site 2 with site 1 temperature data, it can be noted that both site show large increases during the day, but site 2 shows very high temperature decrease at night. The average value for  $UA_{tank}$  was 19.3 +/- 5 W/C. The same tank was present at site 2 as for site 1. In this case, however, the measured value for  $UA_{tank}$  is about 11 times the nominal value, which indicates a problem with nighttime losses. Further investigation will be done to determine the cause (most likely mixing valve failure, as the owner did not notice the motor running at night). As far as solar operation is concerned, it is important to note that this system showed quite normal operation. The controller on-time and comparison to collector efficiency were all quite within expected bounds, similar to site 1. Nonetheless, net savings from this system are significantly below potential, depending on use patterns (which affect the solar energy needlessly lost before usage the following morning).

## CONCLUSIONS

A method of field monitoring based upon tank calorimetry has been introduced. The method is potentially useful for diagnostics, and for reliability monitoring, where low resolution of energy flow is adequate, and costs must be kept very low. A single channel logger will be quantitatively adequate in cases where the storage tank is accessible, and higher accuracy is achieved when the tank is relatively well-mixed. Accuracy is in the 20-50% range for a single point probe, depending upon draw and system stratification.

Uncertainty can be reduced to 10-20% range by using multiple point probes or a line-averaging probe. Accuracy is also increased when weather is based upon measurement or observation, and when a draw probe is utilized.

## REFERENCES

- (1) Christensen, C., and Burch, J., Monitoring Strategies for Utility Solar Water Heating Projects. NREL report, available from authors, National Renewable Energy Laboratory, 1994
- (2) SRCC-OG300: Operating Guidelines and Minimum Standards for Certifying Solar Water Heating Systems. Solar Rating and Certification Corporation, Washington, D.C., 1993
- (3) Jim Huggins, Florida Solar Energy Center, private communication and unpublished seminar talk at 1994 Winter ASME Solar Conference, San Francisco
- (4) Barker, G., Burch, J., and Hancock, E., Field Tests of a Short-term Monitoring Method for Solar Domestic Hot Water Systems, Proceedings ASME Winter 89 Conference, 1989
- (5) Murley, C., Osborn, D., SMUD's Residential and Commercial Solar Domestic Hot Water Programs, Proceedings 94 ASES Conference, American Solar Energy Society 1994

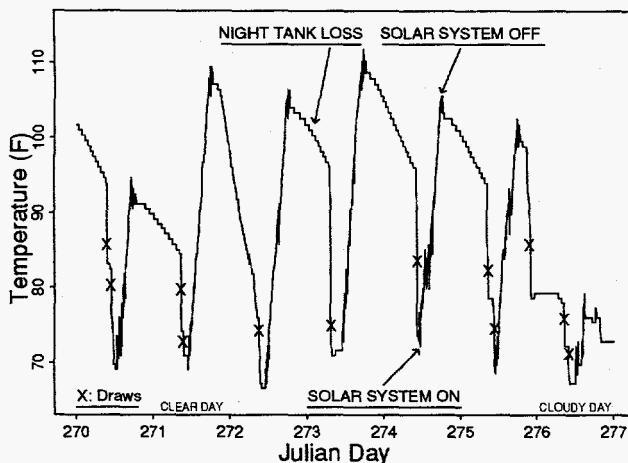


Fig. 1 Tank temperature versus time at site 1. The probe was located near the middle of solar storage.

$$dQ_{\text{draw}}/dt + dQ_{\text{loss}}/dt + dQ_{\text{solar}}/dt = dQ_{\text{int}}/dt$$

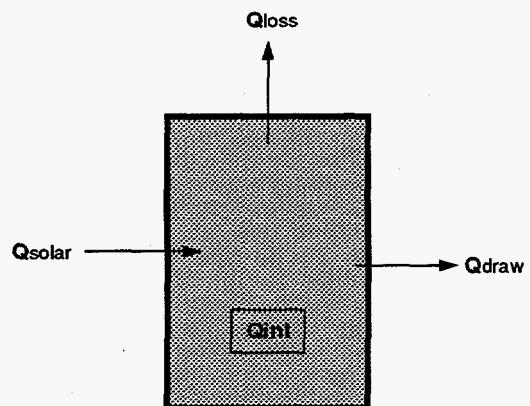


Fig. 2 Tank energy balance, showing energy gains and losses for the solar storage. In one-tank systems, the control volume is drawn below the auxiliary storage.

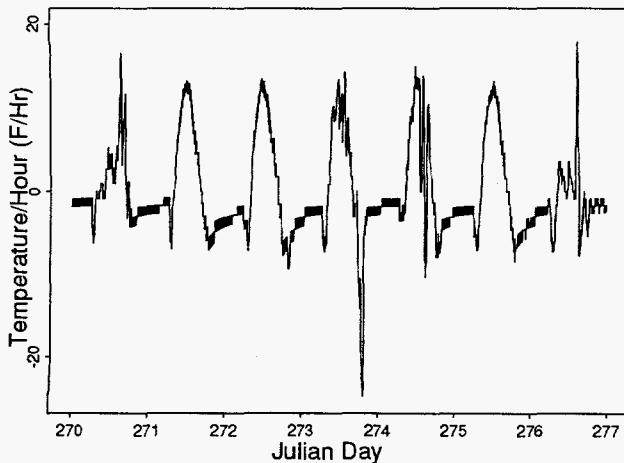


Fig. 3 Tank temperature time derivative versus time for 7 days of data at site 2. For most clear days, there seems to be little evidence of draw, except for day 273.

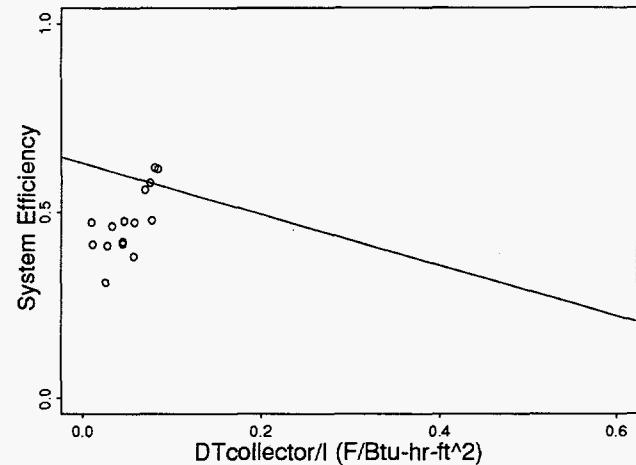


Fig. 5 Collector efficiency versus collector operating parameter  $T^*$ . Data points displayed as open circles are the daily clear day efficiency, calculated as explained in the text.

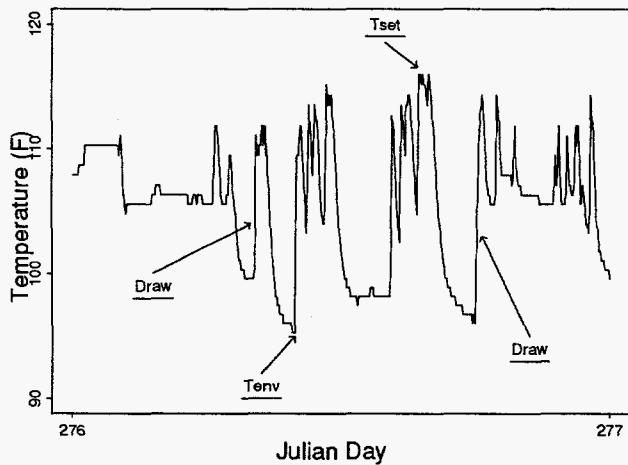


Fig. 4 Tank outlet pipe temperature versus time for site 4. The figure indicates that rapid temperature increase implies a draw is occurring, that equilibrium temperature provides a measure of  $T_{env}$ , and that the maximum temperature after a draw indicates the tank outlet temperature.

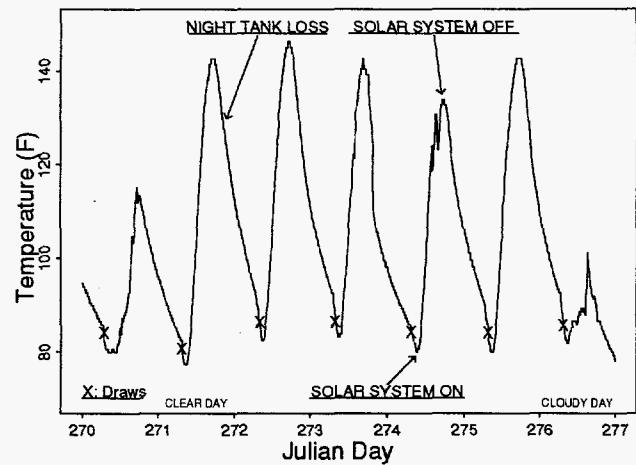


Fig. 6 Tank temperature versus time at site 2. The probe was located near the middle of solar storage, identically to site 1. Compare the rapid nighttime decrease in decrease of site 2 versus that of site 1.